

NOTES

All dimensions in millimetres

Precast concrete flags to comply with BS.EN.1339:2003

Flags shall be 63mm. thick and except where cutting is necessary of width 450 or 600mm. , a minimum length of 450mm. and a maximum length of 900mm.

Item coverage to include for supply and layering 25mm. compacted thickness of designation (iii) dry mix mortar bedding course.


Flags shall be laid with a bond of 300mm. This may be varied where economical use of flags dictate, but shall not be less than 150mm.

All joints shall not be less than 5mm. nor more than 10mm. width.


Joints shall be filled with designation (i) mortar and key pointed. With coloured flags, a similarly coloured mortar shall be used.

Flags shall be protected during joint filling so that mortar staining of the flags adjacent to the joint is prevented.


Concrete infill around obstructions should not exceed 25mm in width and should be the full depth of the flag and similarly coloured.

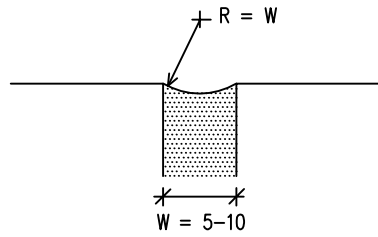

DETAIL OF POINTING

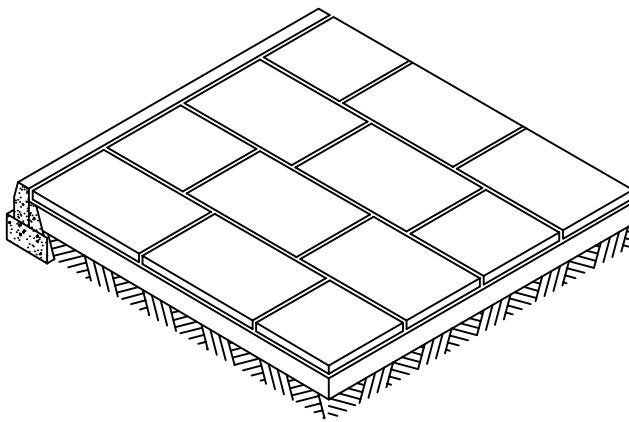

PAVING LAYOUT

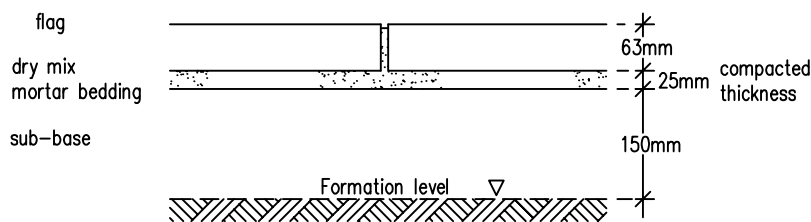

SECTIONAL ELEVATION